CLEAN AGENT (FK-5-1-12) STORED PRESSURE 2 KG MS BODY FIRE EXTINGUISHER

Applicable Class of fire - A, B, C and electrically started fires.

Brief description: These extinguishers come with nominal charge of 2 kg clean agent **(FK-5-1-12)** UL Listed gas, Constructed of MS Sheet of 1.5 mm thickness and brass forged discharge valve with MS lever.

1	**GENERAL DATA**		
	Manufacturer	:	Intime Fire Appliances Pvt. Ltd.
	Trade Mark	:	"**INTIME**"
	BIS standard code	:	IS 15683:2018
	Type	:	Portable Stored Pressure
2	**MATERIAL OF CONSTRUCTION**		
	Extinguishing medium	:	Clean agent (FK-5-1-12) UL Listed gas
	Body	:	MS sheet of 1.5 mm Thickness
	Neck Ring	:	MS Pipe - M30x1.5 Female threaded
	Valve	:	Brass - M30x1.5 Male threaded
	Siphon tube	:	PVC / Aluminum
	Discharge Nozzle	:	Aluminum
	Pressure gauge / indicator	:	As per IS 15683:2018
	Wall mounting bracket	:	MS Powder coated / Chrome Plated
3	**PERFORMANCE DATA**		
	Fire rating	:	1A : 21B
	Performance requirements	:	**Min. Effective discharge time :** 8 Sec. (Actual : 9 Sec. Approx.)
		:	**Min. Bulk range of discharge :** 2 Mtr. (Actual : 3.5 Mtr. Approx.)
		:	**Min. Percentage of discharge :** 95% (Actual : 96% Approx.)
	Temperature Range	:	-30° to +60° C
	Service pressure	:	15 bar
	Max. service pressure	:	18 bar
4	**ROUTINE TESTS**		
	Hydro Pressure Test (Pt)	:	35 bar (3.5 MPa) Hold for 2.5 min.
	Min. Burst pressure (Pb) for body	:	55 bar (5.5 MPa) Hold for 1 min.
	Leakage test	:	Inverted glass jar / Soap solution
5	**TYPE TESTS**	:	As per IS 15683:2018
6	**DIMENSIONS**	:	**Diameter :** 108 ± 10 mm
		:	**Height :** 350 ± 10 mm Approx.
	Thickness of sheet	:	Made up from 1.5 mm thick sheet
	Full weight of extinguisher	:	4.5kg (Approx.)
7	**ANTI-CORROSIVE TREATMENT**	:	Phosphate treatment followed by epoxy powder coating of body DFT not less than 50 Micron
8	**MISCELLEANEOUS**		
	Inspection & testing	:	As per approved QAP
	Finish	:	PO Red as per IS : 5 (Shade 538)
	Marking	:	As per IS 15683:2018
	Approvals	:	BIS / PED
	Maintenance, care and refilling	:	As per IS 2190
9	**IN BOX ACCESSORIES**	:	Wall mounting bracket
10	**PACKING**	:	Corrugated boxes

MARKING: AS PER IS 15683:2018

APPROVAL : PED MARKED


DESIGN DATA

SR. NO	PARTICULARS	DESCRIPTION
01	CAPACITY	2 KG
02	TEMPERATURE RANGE	-20°C TO +60°C
03	SERVICE PRESSURE	15 bar
04	MAX. SERVICE PRESSURE	18 bar
05	PRESSURE TEST (PT)	35 bar HOLD FOR 2.5 min.
06	MIN. BURST PRESSURE TEST (PB)	55 bar HOLD FOR 1 min.

PERFORMANCE PARAMETERS

SR. NO	PARTICULARS	DESCRIPTION
01	EFFECTIVE DISCHARGE TIME	MIN. 8 SEC. (Actual: 9 sec. aprx.)
02	BULK RANGE OF DISCHARGE	MIN. 2 METER (Actual: 3.5 meter aprx.)
03	PERCENTAGE OF DISCHARGE	NOT LESS THAN 95% (Actual: 96% aprx.)
04	FIRE RATING	1A: 21B

HARD PUNCH MARKING
INTIME YEAR PT 35 BAR CE 1128

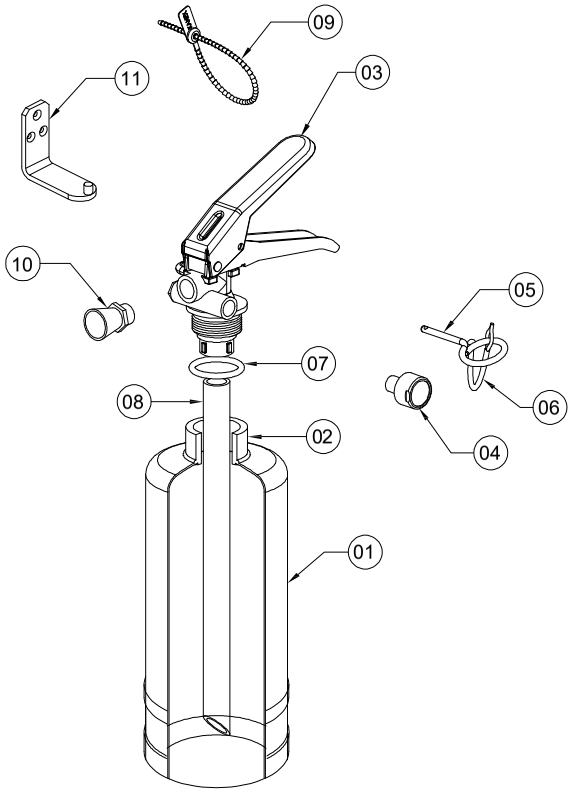



12	EXTINGUISHING MEDIUM	CLEAN AGENT (FK-5-1-12) UL LISTED GAS	02
11	WALL MOUNTING BRACKET	MS POWDER COATED / CHROME PLATED	01
10	NOZZLE	ALUMINUM	01
09	SEAL	PP PLASTIC	01
08	SIPHON TUBE	ALUMINUM / PVC	01
07	"O" RING	NITRILE RUBBER	01
06	SAFETY PIN HOLDER	RUBBER / SOFT PVC	01
05	SAFETY PIN	MS CHROME PLATED	01
04	PRESSURE GAUGE / INDICATOR	AS PER IS 15683:2018	01
03	VALVE	BRASS - M30 X 1.5 MALE THREADED	01
02	NECK RING	MS PIPE - M30 X 1.5 FEMALE THREADED	01
01	BODY	MILD STEEL SHEET OF 1.5 MM THICKNESS	01
SR. NO	DESCRIPTION	MATERIAL	QTY.

					DATE	NAME
				DRAWN	22.12.22	VIJAY
				CHECK	22.12.22	VISHAL
				APP	22.12.22	AM
SYMBOL	REVISION DECRIPTION	DATE	BY			

TITLE :
CLEAN AGENT (FK-5-1-12) (STORED PRESSURE)
MS BODY 2 KG FIRE EXTINGUISHER

GAD NO. : INTIME-CLEAN AGENT-2-SP-MS

SCALE : NTS | SHEET : 1 OF 1

INTIME FIRE APPLIANCES PVT LTD
R.O. : 21/A, Ghanshyam Industrial Estate, Veera Desai Road, Andheri (W), Mumbai - 400053. Telephone : +91 22 2673 1829/ 2673 1852/ 4501 4392
WORKS: D-24/6, TTC Industrial Area, MIDC, Turbhe, Navi Mumbai - 400705.
Telefax: 27634433 / 64512311 / 64523611.