6 LTR CAPACITY LITHIUM-ION STORED PRESSURE TYPE FIRE EXTINGUISHER

Applicable Class of fire – A, B & Li-Battery Fire.

Brief description: These extinguishers come with nominal charge of 6 ltr FFX Lion liquid, Body constructed of MS Sheet by MIG Welding process and brass forged discharge Valve with MS lever, Internally plastic coated & Externally epoxy powder coated.



1	**GENERAL DATA**		
	Manufacturer	:	**Intime Fire Appliances Pvt. Ltd.**
	Trade Mark	:	**"INTIME"**
	Standard code	:	As per IS:15683:2018
	Type	:	Portable Stored Pressure
2	**MATERIAL OF CONSTRUCTION**		
	Extinguishing medium	:	FFX® Lion Flourine Free Solution
	Body	:	MS Sheet of 1.5 mm thickness
	Neck Ring	:	MS Pipe - M30x1.5 Female threaded
	Valve	:	Brass - M30x1.5 Male threaded
	Siphon tube	:	PVC / Plastic
	Pressure gauge / indicator	:	As per IS 15683:2018
	Discharge hose	:	Rubber braided hose (Burst pressure 55 bar)
	Discharge nozzle	:	Plastic
	Wall mounting bracket	:	MS - Chrome plated
3	**PERFORMANCE DATA**	:	
	Fire rating	:	2A 21B
	Performance requirements	:	**Min. Effective discharge time** : 15 Sec. (Actual : 29 Sec. Approx.)
		:	**Min. Bulk range of discharge** : 2 Mtr. (Actual : 4 Mtr. Approx.)
		:	**Min. Percentage of discharge** : 90% (Actual : 97% Approx.)
	Temperature Range	:	+5° to +60° C
	Service pressure	:	15 bar
	Max. service pressure	:	18 bar
4	**ROUTINE TESTS**		
	Hydro Pressure Test (Pt)	:	35 bar (3.5 MPa) Hold for 60 sec.
	Min. Burst pressure (Pb) for body	:	55 bar (5.5 MPa) Hold for 60 sec.
	Leakage test	:	Inverted glass jar / Soap solution
5	**DIMENSIONS**	:	**Diameter** : 160 ± 10 mm
		:	**Height** : 510 ± 10 mm Approx.
	Thickness of sheet	:	Made up from 1.5 mm thick sheet
	Full weight of extinguisher	:	9.2 kg (Approx.)
6	**MISCELLEANEOUS**		
	Marking	:	As per IS
	Maintenance, care and refilling	:	As per IS 2190
7	**IN BOX ACCESSORIES**	:	Wall mounting bracket,Hose with Nozzle,Bottom
8	**PACKING**	:	Corrugated boxes


MARKING: AS PER IS 15683:2018

DESIGN DATA

SR. NO	PARTICULARS	DESCRIPTION
01	CAPACITY	6 Ltr
02	TEMPERATURE RANGE	+5° to +60° C
03	SERVICE PRESSURE	15 bar
04	MAX. SERVICE PRESSURE	18 bar
05	PRESSURE TEST (PT)	35 bar (3.5 MPa) Hold for 60 sec.
06	MIN. BURST PRESSURE TEST (PB)	55 bar (5.5 MPa) Hold for 60 sec.

PERFORMANCE PARAMETERS

SR. NO	PARTICULARS	DESCRIPTION
01	EFFECTIVE DISCHARGE TIME	MIN. 15 SEC. (Actual: 29 sec. aprx.)
02	BULK RANGE OF DISCHARGE	MIN. 2 METER (Actual: 4 meter aprx.)
03	PERCENTAGE OF DISCHARGE	NOT LESS THAN 90% (Actual: 97% aprx.)
04	FIRE RATING	2A 21B

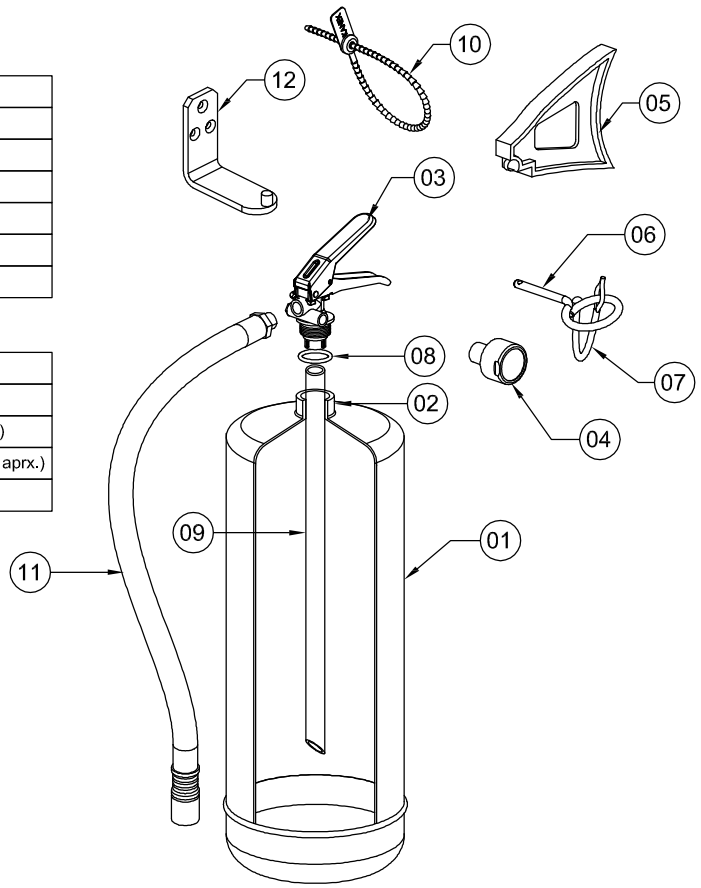



SR. NO	DESCRIPTION	MATERIAL	QTY.
13	EXTINGUISHING MEDIUM	FFX® LION FLOURINE FREE SOLUTION	06
12	WALL MOUNTING BRACKET	MS POWDER COATED / CHROME PLATED	01
11	HOSE WITH NOZZLE	RUBBER BRAIDED EPDM HOSE WITH PVC NOZZLE (BURST PRESSURE 55 BAR)	01
10	SEAL	PP PLASTIC	01
09	SIPHON TUBE	PVC / PLASTIC	01
08	"O" RING	NITRILE RUBBER	01
07	SAFETY PIN HOLDER	RUBBER / SOFT PVC	01
06	SAFETY PIN	MS CHROME PLATED	01
05	LEAVER LOCK	PP PLASTIC	01
04	PRESSURE GAUGE / INDICATOR	AS PER IS 15683:2018	01
03	VALVE	BRASS - M30 X 1.5 MALE THREADED	01
02	NECK RING	MS PIPE - M30X1.5 FEMALE THREADED	01
01	BODY	MS SHEET OF 1.5 MM THICKNESS	01

					DATE	NAME
				DRAWN	02.10.23	VIJAY
				CHECK	02.10.23	VISHAL
				APP	02.10.23	AM
SYMBOL	REVISION DECRIPTION	DATE	BY			

TITLE :
LITHIUM-ION STORED PRESSURE TYPE
6 Ltr FIRE EXTINGUISHER

GAD NO. : INTIME-TDS-STFXL6

INTIME FIRE APPLIANCES PVT LTD
R.O.: 21/A, Ghanshyam Industrial Estate, Veera Desai Road, Andheri (W), Mumbai - 400053. Telephone : +91 22 2673 1826/ 2673 1852/ 4601 4392
WORKS: D-24/6, TTC Industrial Area, MIDC, Turbhe, Navi Mumbai - 400705.
Telefax: 27634433 / 64512311 / 64523611.

SCALE : NTS | SHEET : 1 OF 1